

COMETA 2012

1st INTERNATIONAL SCIENTIFIC CONFERENCE

28th - 30th November 2012.

Jahorina, B&H, Republic of Srpska



University of East Sarajevo

Faculty of Mechanical Engineering

Conference on Mechanical Engineering Technologies and Applications

Z B O R N I K R A D O V A

P R O C E E D I N G S

Isto no Sarajevo . Jahorina, BiH, RS
28-30. Novembar 2012.

East Sarajevo . Jahorina, B&H, RS
28th . 30th November 2012.

ZBORNİK RADOVA SA 1. ME UNARODNE
NAU NE KONFERENCIJE
+Primijenjene tehnologije u mazinskom inženjerstvu+
COMETA 2012, Isto no Sarajevo - Jahorina 2012.

PROCEEDINGS OF THE 1st INTERNATIONAL
SCIENTIFIC CONFERENCE
+Conference on Mechanical Engineering
Technologies and Applications+
COMETA 2012, East Sarajevo - Jahorina 2012.

Organizator: Univerzitet u Isto nom Sarajevu
Mazinski fakultet Isto no Sarajevo

Organization: University of East Sarajevo
Faculty of Mechanical Engineering East Sarajevo

Izdavač: Univerzitet u Isto nom Sarajevu
Mazinski fakultet Isto no Sarajevo

Publisher: University of East Sarajevo
Faculty of Mechanical Engineering East Sarajevo

Za izdavača: Prof. dr Mitar Novakovi
For publisher: Prof. dr Duzan Golubovi

Glavni i odgovorni urednik: Prof. dr Ranko Antunovi
Editor:

Tehnička obrada i dizajn: Mr Saza Prodanovi , dipl. ing. maz.
MSc Miroslav Milutinovi , dipl. ing. maz.

Technical treatment and desing: Sr an Vaskovi , dipl. ing. maz.
Mr Milija Kraiznik, dipl. ing. maz.
Davor Mili , dipl. ing. maz.

Izdanje: Prvo; 1 opti ki disk (CD-ROM)
Printing: 1st ; optical disc (CD-ROM)

Registar: ISBN 978-99938-655-5-1
Register:

Tiraž: 180 primjeraka
Circulation: 180 copies

INTERNATIONAL SCIENTIFIC COMMITTEE

Prof.dr Duzan Golubovi , FME UES (B&H) - president
Dr.-Ing. Stefan Wagner, IFU, University of Stuttgart (Germany)
Prof.dr Athanasios Mihailidis, Aristotle University of Thessaloniki (Greece)
Prof.dr Nenad Gubeljak, TF Maribor (Slovenia)
Prof.dr Aleksandar Veg, FME Belgrade, (Serbia)
Prof.dr Ranko Antunovi , FME UES (B&H)
Prof.dr Károly Kardos, Szechenyi Istvan University of Győr (Hungary)
Prof.dr Stevan Stankovski, FTS Novi Sad, (Serbia)
Doc.dr Nebojza Radi , FME UES (B&H)
Prof.dr.-Ing. Sava Ianici, University Resita "Eftimie Murgu" (Romania)
Prof.dr Milosav Ognjanovi , FME Belgrade, (Serbia)
Prof.dr Miroslav Rogi , FME Banja Luka, (B&H)
Prof.dr Slavko Arsovski, FME Kragujevac (Serbia)
Prof.dr Dra0an Kozak, FME Slavonski Brod (Croatia)
Prof.dr Zoran Ljuboje, FEE UES (B&H)
Prof.dr Toma0 Rodi , NTF Ljubljana, (Slovenia)
Prof.dr Dragiza Viloti , FTS Novi Sad, (Serbia)
Prof.dr Ejub D0aferovi , FME Sarajevo, (B&H)
Prof.dr Ljubodrag Tanovi , FME Belgrade, (Serbia)
Prof.dr Miroslav Verez, SUT Bratislava (Slovakia)
Prof.dr Siniza Kuzmanovi , FTS Novi Sad, (Serbia)
Prof.dr.-Ing. Ljubomir Dimitrov, TU Sofija (Bulgaria)
Prof.dr Milan Zeljkovi , FTS Novi Sad, (Serbia)
Prof.dr Novak Nedi , FME Kraljevo (Serbia)
Prof.dr Safet Brdarevi , FME Zenica (B&H)
Prof.dr Milomir Gazi , FME Kraljevo (Serbia)
Prof.dr Ilija osi , FTS Novi Sad, (Serbia)
Prof.dr Petar Gvero, FME Banja Luka, (B&H)
Prof.dr Goran Jankes, FME Belgrade, (Serbia)
Prof.dr Vojislav Novakovi , NTNU Trondheim (Norway)
Prof.dr Milan ¥ljivi , FME Banja Luka, (B&H)
Prof.dr Dragoljub Živkovi , FME Niz (Serbia)
Prof.dr Marko Serafimov, FME Skoplje (Macedonia)
Doc.dr Biljana Markovi , FME UES (B&H)
Prof.dr Slavko Krajcar, FER Zagreb (Croatia)
Prof.dr Petar Novak, VSTS Novo Mesto (Slovenia)
Prof.dr Rade Ivankovi , PMF UES (B&H)
Prof.dr Petar Stankov, FME Sofija (Bulgaria)
Prof.dr Vojislav Miltenovi , FME Niz (Serbia)
Prof.dr Risto Cicanov, FME Skoplje (Macedonia)
Prof.dr Sead Delali , FME Tuzla (B&H)
Prof.dr Slobodan Stojadinovi , TF Zrenjanin (Serbia)
Prof.dr Hotimir Li en, FTS Novi Sad, (Serbia)
Prof.dr Miodrag Bulatovi , FME Podgorica (MNE)
Prof.dr Ranko Bo0i kovi , FTTE UES (B&H)
Prof.dr Dragan Mil i , FME Niz (Serbia)
Prof.dr Darko Petkovi , FME Zenica (B&H)
Prof.dr Vojislav Filipovi , FME Kraljevo (Serbia)
Prof.dr Zdravko Krivokapi , FME Podgorica (MNE)
Prof.dr Milenko Obad, FME Mostar (B&H)
Prof.dr Lepasava ¥i anin, FTS Novi Sad, (Serbia)
Prof.dr Miloz Sorak, TF Banja Luka, (B&H)
Prof.dr Perica Gojkovi , FTTE UES (B&H)
Prof.dr Duzan Vukojevi , FME Zenica (B&H)

REVIEWERS

Prof.dr Duzan Golubovi , (B&H)
Dr.-Ing. Stefan Wagner, (Germany)
Prof.dr Aleksandar Veg, (Serbia)
Prof.dr Gorazd Hlebanja, (Slovenija)
Prof.dr Ranko Antunovi , (B&H)
Doc.dr Nebojza Radi , (B&H)
Prof.dr Milosav Ognjanovi , (Serbia)
Prof.dr Slavko Arsovski, (Serbia)
Prof.dr Ljubodrag Tanovi , (Serbia)
Prof.dr Milan Zeljkovi , (Serbia)
Prof.dr Novak Nedi , (Serbia)
Prof.dr Milomir Gazi , (Serbia)
Prof.dr Petar Gvero, (B&H)
Prof.dr Milan ¥ljivi , (B&H)
Doc.dr Biljana Markovi , (B&H)
Prof.dr Vojislav Miltenovi , (Serbia)
Prof.dr Ranko Bo0i kovi , (B&H)
Prof.dr Dragan Mili , (Serbia)
Prof.dr-Ing Imre Kiss, (Rumunija)

ORGANIZATION COMMITTEE

Prof.dr Ranko Antunovi , - president
Doc.dr Stojan Simi ,
Doc.dr Źarko Petrovi ,
Doc.dr Slaviza Moljevi ,
Doc.dr Bogdan Mari ,
Mr Saza Prodanovi , senior assistant,
MSc Miroslav Milutinovi , senior assistant,
Mr Aleksandar Kozarac, senior assistant,
Mr Vlado Medakovi , senior assistant,
Mr Milija Kraiznik, senior assistant,
Mrs. Vera Macura, director manager
Spasoje Trifkovi , senior assistant,
Sr an Vaskovi , senior assistant
Davor Mili , assistant,
Dejan Jeremi , assistant,

GENERAL SPONSOR

Ministry of Science and Technology Republic of Srpska



SPONSORS



Brüel & Kjær Vibro

The conference has been supported by:



***International Federation for
the Promotion of Mechanism
and Machine Science***



**Association for Design,
Elements and Constructions**

CIP -

621.03(082)

" COMETA (1; 2012 ;)
Zbornik radova [Elektronski izvor] =Proceedings / 1. meunarodna naučna konferencija "Primijenjene tehnologije u mehanici i inženjerstvu" COMETA 2012, Istočno Sarajevo - Jahorina, 28-30 Novembar 2012. =1th International Scientific Conference "Conference on Mechanical Engineering Technologies and Applications" COMETA, 2012, East Sarajevo - Jahorina 28th-30th November 2012. ; [glavni i odgovorni urednik, editor Ranko Antunovi]. - 1 izd. . Istočno Sarajevo : Mehanički fakultet, 2012. . 1 optički disk (CD-ROM) : tekst ; 12 cm

Radovi na srp. i engl. jeziku

ISBN 978-99938-655-5-1

COBISS.BH-ID 3367448

PREFACE

Production in developed countries is based on the modernization and optimization of the production processes with the application of new technologies that are the result of scientific research. The application of new technology enables companies efficient production and competitiveness in the world market.

Faculty of Mechanical Engineering, University of East Sarajevo, organizes the First international conference "COMETa2012 - Conference on Mechanical Engineering Technologies and Application", which has tasks: to increase economic competitiveness in the region and the create a unique European Research Area.

Globally, the worldwide we are witnessing a rapid development and a host of new technological solutions, which occur primarily in the multidisciplinary development (mechatronics) but also in development of completely new technologies, such as nanotechnology, new energy sources, intelligent machines and processes, micro-technique, etc. All of this puts researchers and engineers in the new challenges and creates opportunities for products and technologies that provide a precondition for economic recovery and creation of new jobs.

COMETa2012 conference program structure is consisted of the following thematic areas: Production technologies and advanced materials, Applied mechanics and mechatronics, Development of products and mechanical systems, Energetics and thermo - technique, Renewable energy and environmental protection, Quality, management and organization, Maintenance and technical diagnostics.

Participation in international conference COMETa2012 was achieved by: 182 authors from 9 countries, with a total of 90 papers, including 4 plenary and 3 of introductory, 4 leading commercial companies and many small and medium enterprises. Bruel & Kjeaar Workshop: "Measurement of noise and vibration", was also organized at the conference, as well as a round table discussion: "The importance of quality infrastructure of B&H within the European integration".

The presence of a large number of participants from Bosnia and Herzegovina and abroad as well as the problems which are processed at the conference, coincide with the themes promoted by the European Union in its development programs.

On the basis of previous exposure, a gathering of scientists and researchers at the international conference COMETa should be understood not only as an exchange of knowledge and achievements of the narrower set of scientists and researchers, but also as a constant and serious attempt to focus social consciousness and social life on activities that ensures progress and prosperity of any society, and that is productive work, creating new knowledge and economic development.

On behalf of the Organizing Committee of the Conference COMETa2012, thank all authors, reviewers, as well as institutions, companies and individuals who contributed to realization of the Conference.

East Sarajevo, October 28th, 2012.

President of the Organizing Committee

Prof. dr Ranko Antunović



39. **Dragoslav Janošević, Nikola Petrović, Vesna Nikolić, Jovan Pavlović**
ANALYSIS OF HYDRULIC CRAWLER TRACTORS TRANSMISSION 309
40. **Marko Miletić, Mirko Blagojević, Snežana Vulović, Ivan Miletić**
CONTACT SURFACE ANALYSIS ON CYCLOID DRIVES WITH SINGLE, DOUBLE AND TRIPLE MESHING 315
41. **Miroslav Milutinović, Milosav Ognjanović, Spasoje Trifković**
DESIGN PARAMETERS IDENTIFICATION OF AUTOMOTIVE GEARBOX BASED ON DESIRED RELIABILITY 323

Session III-2

ENGINEERING EDUCATION AND INNOVATION IN DESIGN Chair: Vojislav Miltenović, Gorazd Hlebanja, Biljana Marković

42. **Tihomir Mačkić, Mirko Blagojević, Živko Babić**
ANALYSIS OF PARAMETERS THAT HAVE AN IMPACT ON CYCLO DRIVE EFFICIENCY 331
43. **Nenad Kostić, Mirko Blagojević, Vesna Marjanović, Zorica Đorđević, Nenad Marjanović**
INFLUENCE OF CYCLOIDAL GEAR PROFILE CORRECTION TO THE NUMBER OF CONTACTS BETWEEN THE ELEMENTS OF A CYCLOIDAL SPEED REDUCER 339
44. **Nada Bojić, Dragan Milčić**
EFFECTS OF VARIOUS PARAMETERS TO SLIDING BEARINGS 347
45. **Miroslav Živković, Miloš Janošević, Snežana Vulović, Nenad Busarac, Marko Topalović**
THERMAL ANALYSIS OF HIGH POWER REDUCTION GEARBOX 355
46. **Biljana Marković, Milan Banić**
REQUIREMENTS FOR DEVELOPING ENGINEERS EDUCATION . HOW TO PARTICIPATE IN INTERNATIONAL PROJECTS? 359
47. **Mirko Blagojević, Zorica Đorđević, Vesna Marjanović, Nenad Marjanović, Blaža Stojanović, Rodoljub Vujanac**
STRESS AND STRAIN STATE OF CYCLOID DISC 367
48. **Dejan Krstić**
IMPACT OF EURO NCAP TESTS ON BODY MODIFICATION IN AUTOMOTIVE INDUSTRY 375

Session IV

ENERGETICS AND THERMO - TECHNIQUE Chair: Dušan Golubović, Mirko Dobrnjac, Buzatu Gabriel Cosmin

49. **Milan Plavšić, Zdravko Božičković, Dušan Golubović**
MATERIALS-RELATED ISSUES IN CATALYTIC AND BOILER-TURBINE PLANTS 383
50. **Miljan Savić, Biljana Marković**
ESTABLISHING ENERGY EFFICIENCY SYSTEM IN ACCORDANCE WITH THE REQUIREMENTS OF EN ISO 50001 391
51. **Vangelce Mitrevski, Tale Geramitcioski, Vladimir Mijakovski, Monika Lutovska**
RISK ASSESSMENT IN NATURAL GAS TRANSMISSION SYSTEM 399
52. **Saša Jovanović, Zorica Đorđević, Milorad Bojić, Slobodan Savić, Biljana Stepanović**
WEATHER CONDITIONS IMPACT ON ELECTRICITY CONSUMPTION 409



WEATHER CONDITIONS IMPACT ON ELECTRICITY CONSUMPTION

Saša Jovanović¹, Zorica Djordjević², Milorad Bojić³,
Slobodan Savić⁴, Biljana Stepanović⁵

Abstract: This paper presents the analysis of the impact of weather conditions on the consumption of electricity for the City of Kragujevac in the five-year period from 2006 to 2010. It points out the mean daily air temperature as the most influential climate (meteorological) parameter, and gives an overview of deviations from the mean values compared to the reference period. Increases and decreases in power consumption depending on the deviations of the mean daily temperature from the normal (average) values are also indicated. In periods of strong and long-lasting cold spells in winter months, there is increased power consumption as a result of heating of residential and office premises. During extremely hot summer periods, there is also a tendency of increased electricity consumption because of home air conditioning. A timely and accurate weather forecast can certainly help prevent the electrical power system overload and reduce the risk of possible power system damage.

Keywords: Weather, Electricity consumption, Cooling, Heating, Climate change

1. INTRODUCTION

Increasing demands for energy and dramatic reductions in reserves of energy resources, primarily fossil fuels, make each research on energy consumption significant.

In recent decades, we have witnessed climate changes for which most scientists believe to be of an anthropogenic origin. An enormous consumption of fossil fuels has led to a significant increase in the concentration of greenhouse gases (CO₂, CH₄, NO₂, etc.) which are considered the main cause of the increase in the global average temperature.

The residential sector has significant electricity consumption in most power systems. Changes in electricity consumption in this sector are associated with changes in weather conditions and they often cause undesirable peaks [3] in the total power consumption within a power system.

Electricity consumption depends on characteristics of the building envelope, quality of the windows and occupant behaviour which further complicates this

¹ Mr Saša Jovanović, Assistant, Kragujevac, Faculty of Engineering Sciences, dviks@kg.ac.rs

² Dr. Zorica Djordjević, Assistant Professor, Kragujevac, Faculty of Engineering Sciences, zoricadj@kg.ac.rs

³ Dr. Milorad Bojić, Full Professor, Kragujevac, Faculty of Engineering Sciences, bojic@kg.ac.rs

⁴ Dr. Slobodan Savić, Associate Professor, Kragujevac, Faculty of Engineering Sciences, ssavic@kg.ac.rs

⁵ Biljana Stepanović, Energetika d.o.o., Kragujevac, bstepanovic@energetika-kragujevac.com

dependence [2, 4, 5]. Important elements [2] in the study of the influence of weather parameters on energy consumption include the local position of the object (orientation, slope, solar radiation, wind exposure, presence of vegetation, etc.) and its geographic position (primarily the climate zone of a particular location).

There is a significant number of papers dealing with the studied topic. The paper [1] shows the analysis of weather sensitivity of household appliances energy consumption (refrigerators, air conditioners, heating, etc.) in Sydney, Australia. The core temperature was established and it was the starting point from which the additional heating or cooling of residential and office premises began. The U.S. Energy Information Agency conducted extensive surveys related to the number of possible influencing factors on the electrical energy consumption in the residential sector [2]. The paper [7] studied the effect of changes in air temperature, wind speed and direction, and relative humidity on the energy consumption and it determined how this effect varied in different climate zones. In the papers [6, 7], the impacts of climate factors, object construction properties, socio-cultural and other factors are considered.

The objective of this paper is to present data on the mean temperature and electricity consumption for a five year period at the City of Kragujevac and then to determine the impact of changes in the mean daily temperature on the power consumption of buildings.

2. METHODS

2.1. Location

The city of Kragujevac (44.02 latitude and 20.93 longitude) has an altitude of about 200 meters with a moderate continental climate.

2.2. The obtained data

Temperature measurements were performed at the meteorological station Kragujevac. The variation in the mean daily air temperature for the City of Kragujevac for a five-year period time from 1 January 2006 to 31 December 2010 was recorded.

The mean daily temperature was calculated based on the equation

$$t_{md} = \frac{1}{24} \sum_{i=1}^{24} t_{hi} \quad (1)$$

where

t_{hi} stands for the measured temperature value for each hour i . The mean daily temperatures were used to calculate the mean monthly temperature as

$$t_{mm} = \frac{1}{n_d} \sum_{i=1}^{n_d} t_{mdi} \quad (2)$$

where t_{mdi} stands for the mean daily temperature for the i -th day of the month and n_d stands for the number of days in the month ($n_d=28, 29, 30$ or 31).

The data on electricity consumption were taken from the transformer station (TS Kragujevac 2). This transformer station supplies the mainly residential area with no significant industrial plants.

The transformer station TS Kragujevac 2 supplies electrical power to the largest part of the City of Kragujevac (about 200 000 inhabitants). Since this is mainly residential area, the ratio of residential to industrial power consumption is 9 to 1. Out of

103 000 consumers supplied by the TS Kragujevac 2, 96 000 are residential consumers. This transformer station supplies power only to 55 industrial consumers, 54 of which are supplied with medium voltage electricity (10 kV and 35 kV), and one of which is connected to the network of high voltage (110 kV). Public lightning has 657 connections.

It is significant to note that in the area covered by the TS Kragujevac there are about 10 000 gas connections and 25 000 users of the remote controlled heating system.

Therefore, the structure of the electric power system of the TS Kragujevac 2 is such that the impact of the air temperature variations on the power consumed for heating or cooling of residential premises is high.

An important factor with a great influence on the level of power consumption is certainly the price of fuels (gas, coal, fuel oil, wood, electric power). The object of our further investigations will be to determine a more accurate relation between the meteorological (climate) parameters and the electrical power consumption.

3. RESULTS

As results of this investigation, diagrams of mean daily temperatures and daily electricity consumptions for the period from 2006 to 2010 are given in Figures 1-5. The gradual increase in the number of customers and in the number of electrical devices that burden the system is not considered.

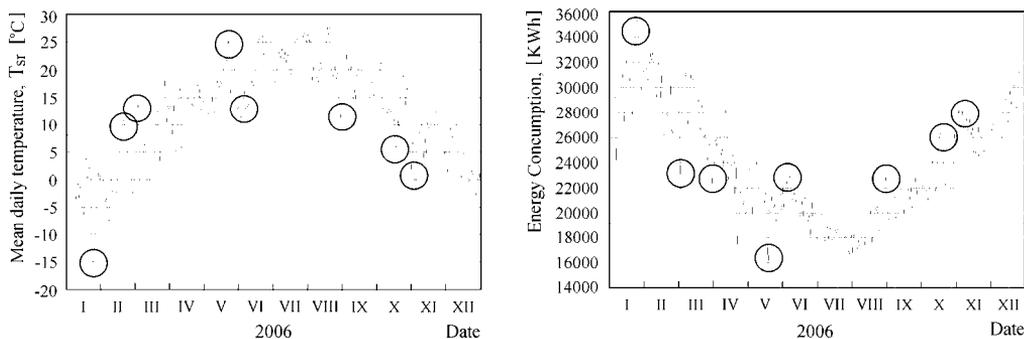


Fig. 1 Mean daily temperature and mean daily electricity consumption for 2006 (Average consumption for a period of 15 min)

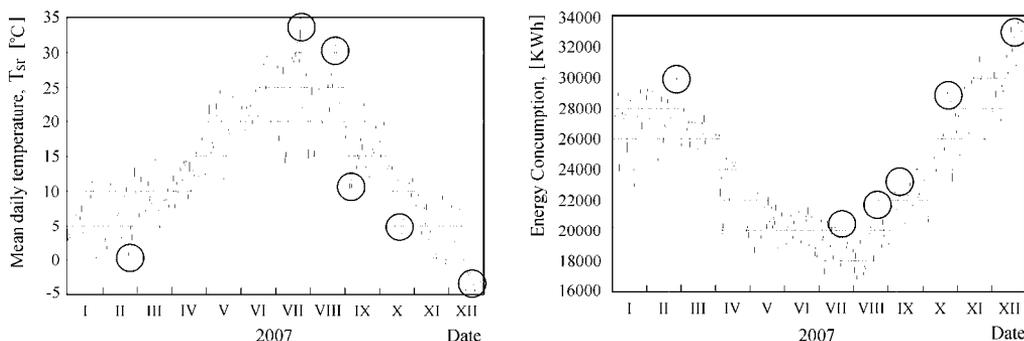


Fig. 2 Mean daily temperature and mean daily electricity consumption for 2007 (Average consumption for a period of 15 min)

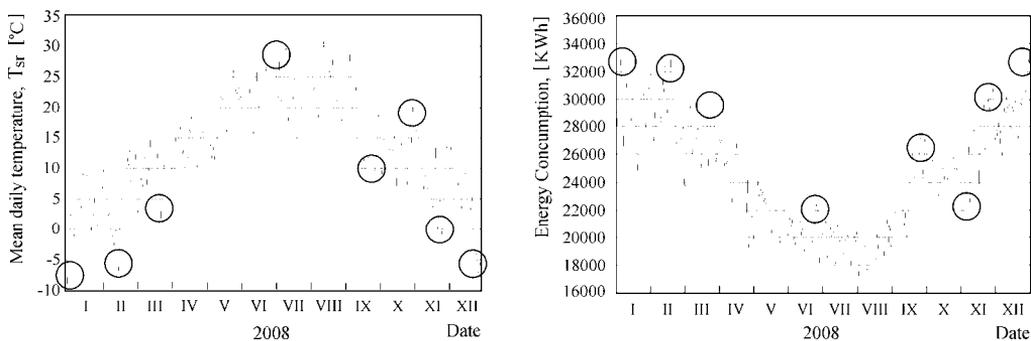


Fig. 3 Mean daily temperature and mean daily electricity consumption for 2008
(Average consumption for a period of 15 min)

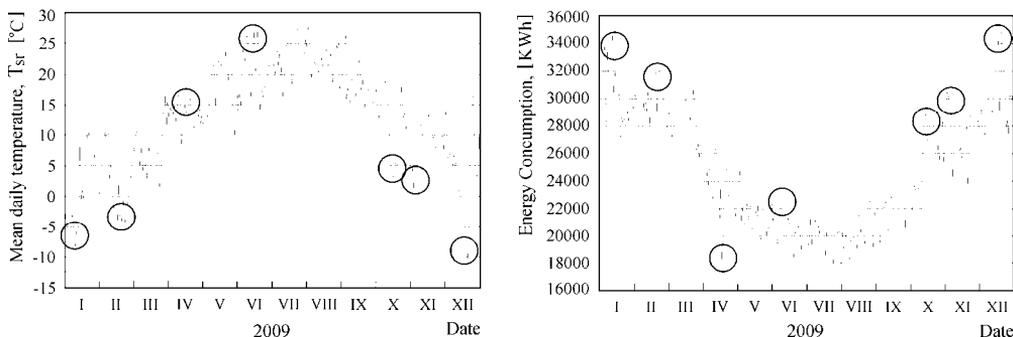


Fig. 4 Mean daily temperature and mean daily electricity consumption for 2009
(Average consumption for a period of 15 min)

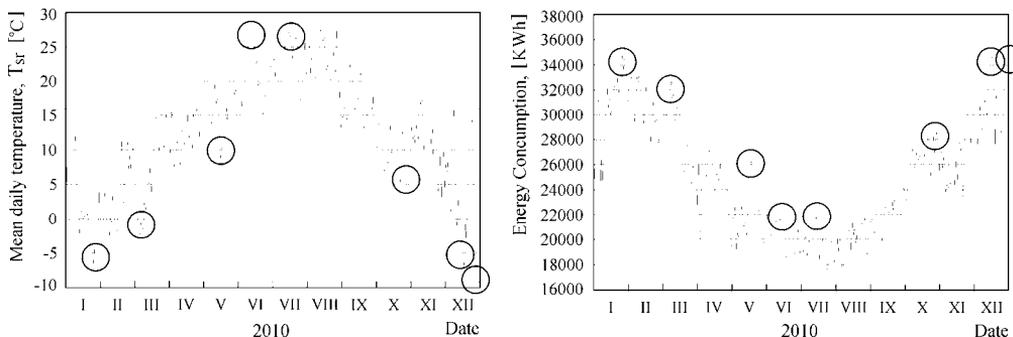


Fig. 5 Mean daily temperature and mean daily electricity consumption for 2010
(Average consumption for a period of 15 min)

4. DISCUSSION

Figures 1-5 show the influence of external temperatures to power consumption by buildings. Peaks in the power consumption (rounded peaks in the diagrams) correspond to the peaks in mean daily temperatures.

In periods of strong cold spells especially in winter months, there is a need for additional heating of residential premises. The amount of electrical power consumed for additional heating depends on a number of factors. Based on the peak intensities in the shown diagrams (Figures 1-5), it can be concluded that the intensity of external

temperature variations is a predominant factor with a great influence on the quantity of additionally consumed electrical power.

The length of strong cold spells or the length of warm spells in winter months also influences the electric power consumption. Other factors that have an influence on the intensity of power consumption peaks include usage of fuels, periods of major religious and state holidays, prices of fuels, construction characteristics of the buildings etc.

Due to obvious climate changes, periods of extremely hot weather in summer have become both more frequent and longer. During these periods, air conditioners are intensively used for cooling of residential premises; therefore, electrical power consumption is significantly increased.

In transient periods (autumn and spring) when the remote controlled heating system is not in function, there is an increased risk of overloading the electric power system.

Geographic location and the climate zone affect the overall dependence of electric power consumption on different weather conditions.

It is observed that there are high peaks in power consumption associated with high (summer) and low (winter) temperature peaks.

There are also some variations in power consumption for minor changes in the air temperature, but they could hardly endanger the operation of the electric power system.

5. CONCLUSION

It is obvious that there is a strong relationship between changes in the external temperature and energy consumption in the residential sector. Based on the diagrams of power consumption for a five-year period (2006-2010) for the City of Kragujevac, it can be concluded that there is high electricity consumption in the residential sector as a response to extreme changes in the mean daily air temperature.

Lower air temperatures (in winter) present a greater danger to operation of the electric power system because the system is already heavily loaded in winter. A timely and accurate weather forecast followed by an appropriate response from both those in control of the power system and the consumers can certainly contribute to energy savings and prevent power system damage with serious consequences.

ACKNOWLEDGEMENT

This investigation is a part of the project TR 33015 of Technological Development of the Republic of Serbia and the projects III 42006 and III 42013 of Integral and Interdisciplinary Investigations of the Republic of Serbia. We would like to thank the Ministry of Education and Science of the Republic of Serbia for the financial support during this investigation.

LITERATURE

- [1] Hart, M., Dear, R., (2004). Weather sensitivity in household appliance energy end-use, *Energy and Buildings*, vol. 36, p. 161-174.
- [2] RECS, Residential Energy Consumption Survey, Energy Information Administration, USA, 1997, from <http://www.eia.doe.gov/emeu/recs/contents.html>.
- [3] Bartels, R., Fiebig, D.G., (2000). Residential end-use electricity demand: results from a designed experiment, *The Energy Journal*, vol. 21, p. 51-81.
- [4] Prins, G., (1992). On condis and coolth, *Energy and Buildings*, vol. 18, p. 251-258.

- [5] Brager, G.S., Dear, R.J., Historical & cultural influences on comfort expectations, The Cross Cultural Transfer of Environmental Building Information, International Research Workshop, University of British Columbia, 2002.
- [6] Ugursal, V.I., Fung, A.S., (1996). Impact of appliance efficiency and fuel substitution on residential end-use energy consumption in Canada, *Energy and Buildings*, vol. 24, p. 137-151.
- [7] Sailor, D.J., Munoz, J.R., (1997). Sensitivity of electricity and natural gas consumption to climate in the USA-methodology and results for eight states, *Energy*, vol. 22, p. 987-998.